



Total Energy Corp

Tank Sketch of field Information ALBERTVILLE

1

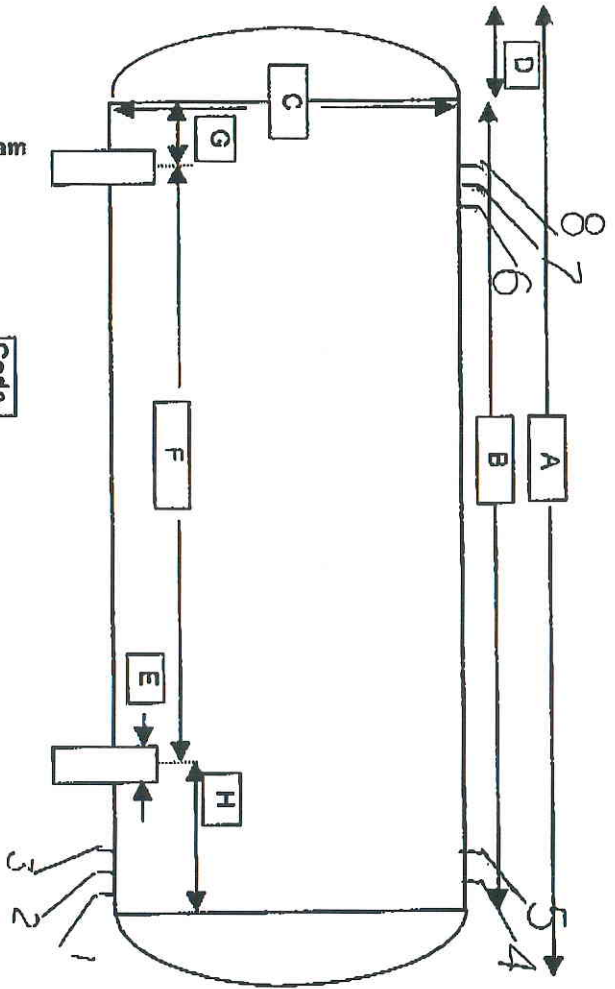

Manway Cover Detail



Outside Dia	28"
No of bolts:	24
Bolt length:	
Bolt dia.:	1 1/4"
Nom. size:	
Rating:	
Type:	

Inches from Head Seam

Tank Openings

Tank Details

Code Plate

U-1 on hand
Heat Treat
X-Ray

Y/N
Y/N
Y/N
N

No	Size	Type	Description	Manufacturer:	JB Bealrd	Type of Head	Description	Dimensions
1	3"	NPT	6"	Liquid	May-05	55	C/A Length	A - 41"
2	3"	NPT	20"	Liquid			Length - weld to weld	B - 32 7/8"
3	2"	NPT	34"	Liquid				C - 109 3/4"
4	2"	NPT	12"	Vapor	Working Pressure	250	Weld to End	D - 4' 2 1/2"
5	3/4"	NPT	24"	Vent Valve	National Board Number		Width of Piers	E - 16"
6	2"	NPT		Internal Relief	Serial Number	64369	C/C of Piers	F - 25' 1"
7	2"	NPT		Internal Relief	Steel Type:		C/L of Piers to Weld end	G - 3' 5"
8	2"	NPT		Internal Relief				H - 4'
9					Jurisdiction #			
10					Pressure Gauge	yes		
11					Liquid Level Gauge	yes Master		
12								
13					Paint Condition:	poor		
14					Color:	white		
15					Relief Valve Type	Internal	Information taken by:	Tracy Gates
16					Test Date		Date:	8/13/2008
17							Tank Location	Albertville, AL